


Swimming pools

A deeper look at energy efficiency

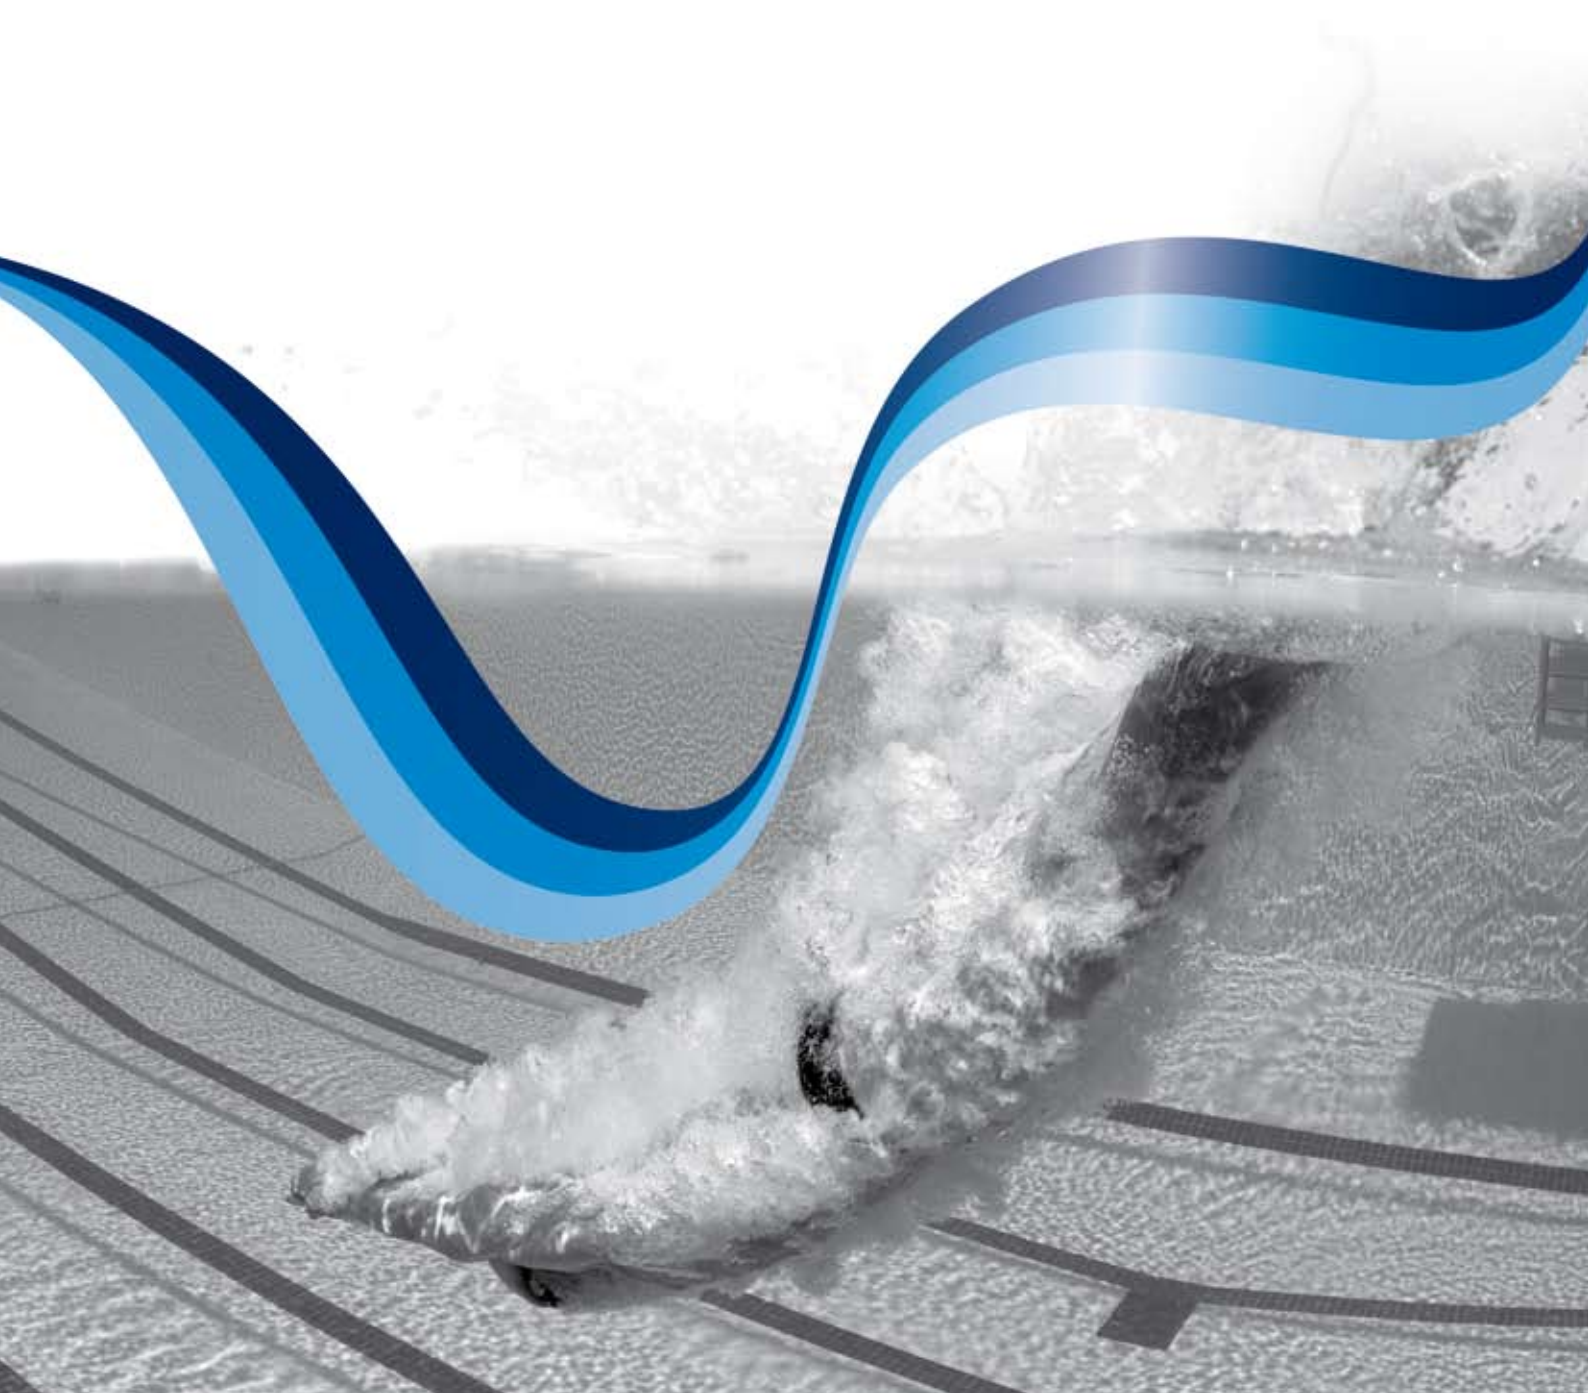

Contents

Introduction	02
Energy consumption	03
Pool halls – space heating and ventilation	05
Pool water – heating and treatment	14
Lighting	19
Motors and pumps	21
Action checklist	22
Next steps	23
Glossary	24

Reducing energy use makes perfect business sense; it saves money, enhances corporate reputation and helps everyone in the fight against climate change.

The Carbon Trust provides simple, effective advice to help businesses take action to reduce carbon emissions, and the simplest way to do this is to use energy more efficiently.

This technology guide introduces the main energy saving opportunities relating to swimming pools and demonstrates how simple actions save energy, cut costs and improve comfort for those who use the facilities.

Introduction

Swimming pool halls consume more energy per unit area than almost any other building type. In fact, they use five times as much energy per square metre as offices, which means extra vigilance in the design and operation of swimming pools is of the utmost importance.

The range of facilities found in the wet leisure sector is vast, from the smallest spa pool to a large Olympic sized facility. While all of these have quite different energy costs, the heating and treating of water in all swimming pools makes consumption patterns similar. As such, the advice given in this publication is applicable to all wet leisure facilities, both indoor and outdoor.

This technology guide has been developed to help pool centre managers and operators ensure that energy is managed efficiently in their swimming pools. With the complex range of associated building services and their considerable energy demand, it is important that opportunities for both carbon and cost savings are highlighted.

All of the technologies discussed in this guide can yield significant savings. This publication will also help managers to:

- Assess the potential for carbon savings and indicate key areas for improvement
- Raise awareness of carbon emissions amongst staff and motivate them to reduce waste
- Appraise the overall energy performance of a swimming pool.

Who is this publication for?

The advice in this publication will be useful to anyone involved in the running of swimming pools, such as those in sports and leisure centres, clubs, hotels or schools. This includes centre managers, energy managers and key decision makers in pool facilities.

This guide contains detailed information aimed at those with a real interest in implementation. It is expected that readers will have prior knowledge and experience of energy efficiency and are familiar with the basic advice given in the Carbon Trust's sector overview publications.

Further information

- [Sports and leisure sector overview \(CTV006\)](#)
- [Hospitality sector overview \(CTV013\)](#)
- [Schools sector overview \(CTV019\)](#)
- [Further and higher education sector overview \(CTV020\)](#)

Why reduce your carbon footprint?

- Save money and increase profits
- Provide better conditions for staff and pool users
- Help combat climate change by cutting carbon emissions
- Help meet local and national sustainability targets
- Attract more customers by demonstrating a social responsibility for reducing carbon emissions.

In a large hotel, the pool alone can account for as much as 10% of total energy costs

Energy consumption

Swimming pool water needs to be continually heated in order to overcome the cooling effect of evaporation and maintain comfortable temperatures. It must also be continuously filtered and treated, so it is not surprising that pools are significant users of energy.

Pool halls and changing areas are typically kept warmer than other spaces as pool users are wet and wear less clothing. Moreover, bathers consume large volumes of shower water which adds to the overall energy consumption of pool facilities.

Using energy efficiently can save up to 25% of overall operating costs of a typical swimming pool. Implementing good energy management techniques can minimise consumption without lowering the standard of service to users.

The major energy consumption areas in an indoor pool hall and their associated costs are shown in Figure 1 below.

In order to achieve the greatest savings potential, pool hall managers should know where the majority of their energy is being consumed and/or wasted. Typical common wastage areas within the wet leisure sector are:

- Space heating and ventilation
- Water heating and treatment
- Lighting
- Motors and drives (particularly for pool pumps and filtration equipment).

Figure 1 Proportion of energy used in an indoor pool



■ Fans and pumps
 ■ Lighting
 ■ Water Heating
■ General power
 ■ Space heating

Figure 2 Cost of energy used in an indoor pool



■ Fans and pumps
 ■ Lighting
 ■ Water Heating
■ General power
 ■ Space heating

In each of the key consumption areas, there are three main opportunities to save energy:

Control – all energy-consuming equipment should be controlled carefully to give the required conditions and switched off when not required.

Maintenance – a number of energy efficiency measures can be carried out as part of routine maintenance for little or no extra cost.

Refurbishment – energy saving measures taken when planning major building refurbishment can be extremely cost-effective.

In most wet leisure facilities, energy is supplied in two forms: fossil fuel (gas, oil, coal or LPG) and electricity. For the majority of sites, space heating and hot water is supplied by fossil fuel. However, some facilities only have access to electricity or use it more extensively. Electricity is also used for lighting, electrical equipment, fans and pumps.

Reducing electricity consumption should take a high priority in an energy efficiency plan as it has higher cost and carbon emissions per kWh used than most fossil fuels. Moreover, most electricity wastage is within the control of end users and can be minimised through good energy management and increased awareness.

Further information

Fact sheets

Understanding your energy consumption (CTL001)

Assessing the energy use in your building (CTL003)

Energy benchmarking

Benchmarking allows a pool owner to compare energy performance with other similar pool buildings across the UK and, over time, with their own previous performance. Calculating a benchmark based on energy consumption per unit of floor area of a pool hall allows direct comparison with other facilities, giving managers an idea of how energy efficient their pool is. The most recent benchmark figures for swimming pools were published in 2001 in the Carbon Trust publication *Energy use in sports and recreation buildings* (ECG078). Although these figures are a little dated, they can still be used as a rough guide to performance relative to other organisations.

A helping hand online

Benchmarks and information on how to calculate your energy use and CO₂ emissions can be found online at www.carbontrust.co.uk/energy

There are lots of opportunities for saving energy and, therefore, money and carbon emissions. Many of these require little or no cost, although others require some investment. The following section gives details of opportunities relevant to all pools.

Pool halls – space heating and ventilation

Space heating and ventilation accounts for a large proportion of energy use in pool halls – which means that there are big opportunities to make savings. However, it is important to ensure that the primary functions of the heating, ventilation and air conditioning system are not compromised.

Ventilating and heating pool halls can be rather complex and it is essential to manage these services correctly. The control of evaporation from the water is a function not normally encountered in standard heating, ventilation and air conditioning (HVAC) systems, and can therefore be misunderstood by designers and operators.

The ventilation system is normally the primary (or only) means of:

- Controlling the pool hall air quality, temperature and humidity so as to reduce evaporation from the pool and prevent condensation (and, potentially, corrosion damage).
- Maintaining comfortable environmental conditions for different occupants.
- Removing contaminants from the air.

Top tip

If a swimming competition attracts many spectators, it may be appropriate to reduce the air (and water) temperature to provide optimum internal comfort conditions.

Comfort requirements

Maintaining satisfactory environmental conditions in the pool hall and all other areas of the building is crucial to the comfort of bathers, lifeguards, staff and spectators. It is also essential if the pool is to operate successfully over its working life.

In addition to the fact that pool users are wet and wearing less clothing, they will also experience evaporation as they dry, which gives a cooling effect. As a result, higher than usual air temperatures need to be maintained. Evaporation also depends on the relative humidity in the air, but bathers are relatively tolerant of changes in humidity provided that air movement is minimised, for instance, by avoiding draughts.

Heating and ventilation of the pool hall has to account for a wide range of factors such as the number of bathers, water temperature, insulation of the pool hall and integration with the building structure. Air and water temperature should be set relative to each other to optimise user comfort and minimise evaporation from the pool water. Above all, humidity and moisture content in the pool hall needs to be controlled to avoid condensation.

Air movement

A pool hall air circulation system needs to distribute air effectively so that:

- Comfortable temperatures are provided for occupants
- Air movement is controlled so it does not produce uncomfortable draughts
- Smells produced by water treatment are removed/reduced
- Evaporation and condensation is minimised.

There are three locations within the pool hall where these issues should be addressed and each one is examined in more detail below. These are: the pool surface, the pool side and other areas, such as upper walls and the ceiling void.

Pool surface

The key elements to be addressed at the pool surface are to remove contaminants if they could affect bathers, to provide bathers with oxygen for respiration and to control evaporation.

- Remove contaminants – although sometimes unpleasant to smell, the odours caused by the water treatment process are not usually dangerous and are generally accepted as part of the swimming pool environment. Instead of relying on ventilation to remove smells, a better approach is to control the water treatment process itself. Contact a water treatment chemical supplier for more information.
- Respiration – bathers need to be able to breathe comfortably; however, as in other spaces, this requirement is met adequately by air diffusion within the pool hall. Coupled with the activity of bathers, this means that no deliberate effort has to be made to deliver air to the bather at the pool surface.

- Evaporation control – air movement at the pool surface encourages evaporation to occur. Therefore, it is better to avoid deliberate air movement such as directing air onto the pool from jets built into the ductwork if other comfort requirements can be met without constantly refreshing the air at the pool surface. Angle jets towards the sides of the pool hall away from the surface of the water.


Pool side

The comfort of the bather (before entering and after leaving the pool) and of the poolside staff are the key elements to be addressed at the pool side.

Most of the people who use the pool hall will be wet, so the poolside temperature should be adjusted accordingly. This can be assisted, for example, by redirecting any grilles and jets near the pool side to avoid any direct air flow from the ventilation system. Staff should also be discouraged from opening doors or windows, which creates draughts.

Discourage poolside staff from opening emergency escape doors for their own personal comfort. If localised cooling is required, this can be provided by increased air movement such as through simple overhead fans. Use controls to avoid increasing air movement at the pool surface or around wet bathers.

Temperatures elsewhere in the swimming pool building, such as café areas, the foyer, administration offices and plant rooms should be appropriate for the activities taking place.

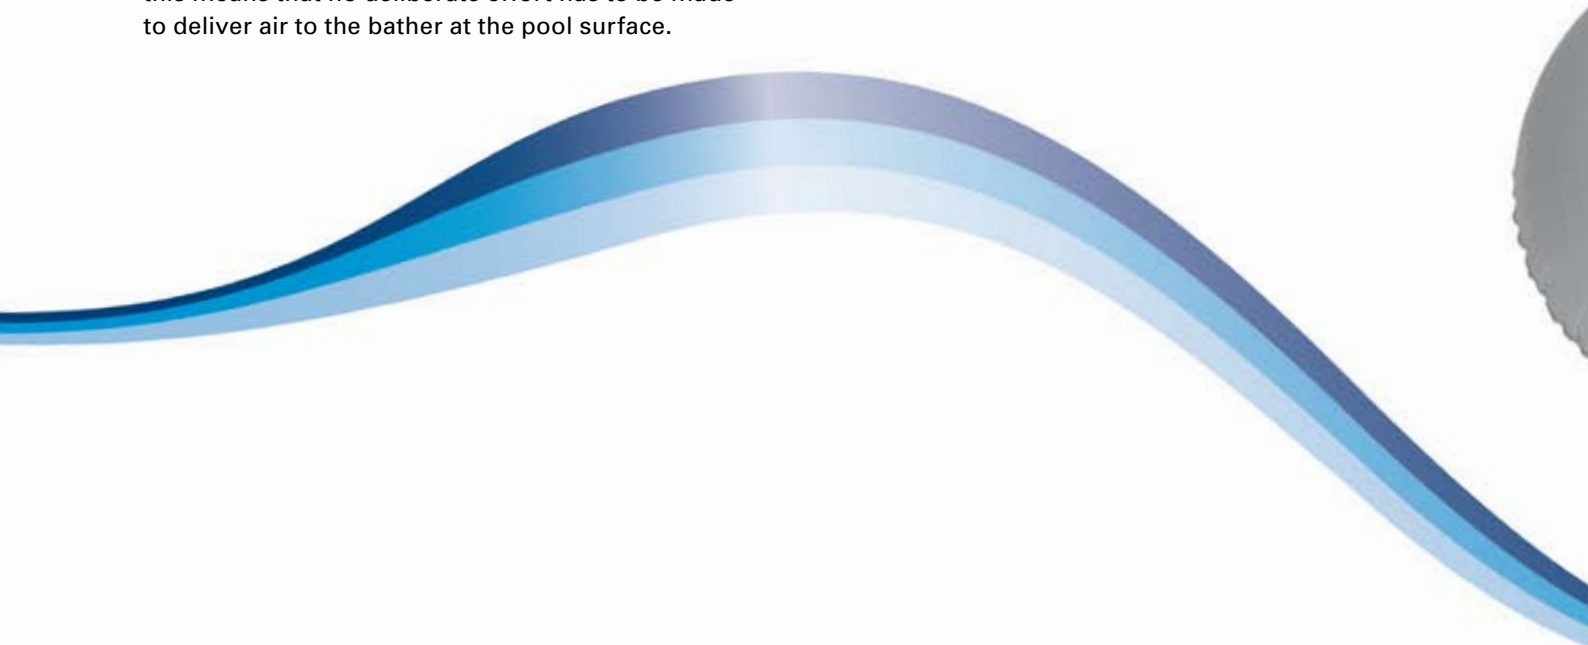

Other areas in the pool building


The key elements to be addressed in other areas of the pool hall are protecting the pool hall structure from condensation and providing comfort to non-swimmers.

One solution to both problems is to provide separate air flows for the pool and other areas to minimise mixing between areas. In a new pool building, the air flow could be directed upwards from a slot at the foot of the walls in 'laminar flow', so that it mixes as little as possible with the bulk of air in the hall. For existing pool buildings, inlet grilles and jets can be repositioned so that drier air entering the pool hall can be pointed towards the sides of the building rather than down on to the pool.

Comfort for spectators can be improved by having a similar arrangement to direct drier incoming air over them. It may also be appropriate to blow drier air into ceiling voids to ensure that condensation does not occur on hidden parts of the structure.

These approaches that separate air flow within the space have clear advantages over a traditional system in which all the air flows are mixed, demanding that all air in the pool hall be brought down to the limiting moisture content demanded for structural protection.

Outside air normally has much less moisture in it than pool hall air as it has a lower temperature. Mixing outside air with pool hall air can reduce overall humidity

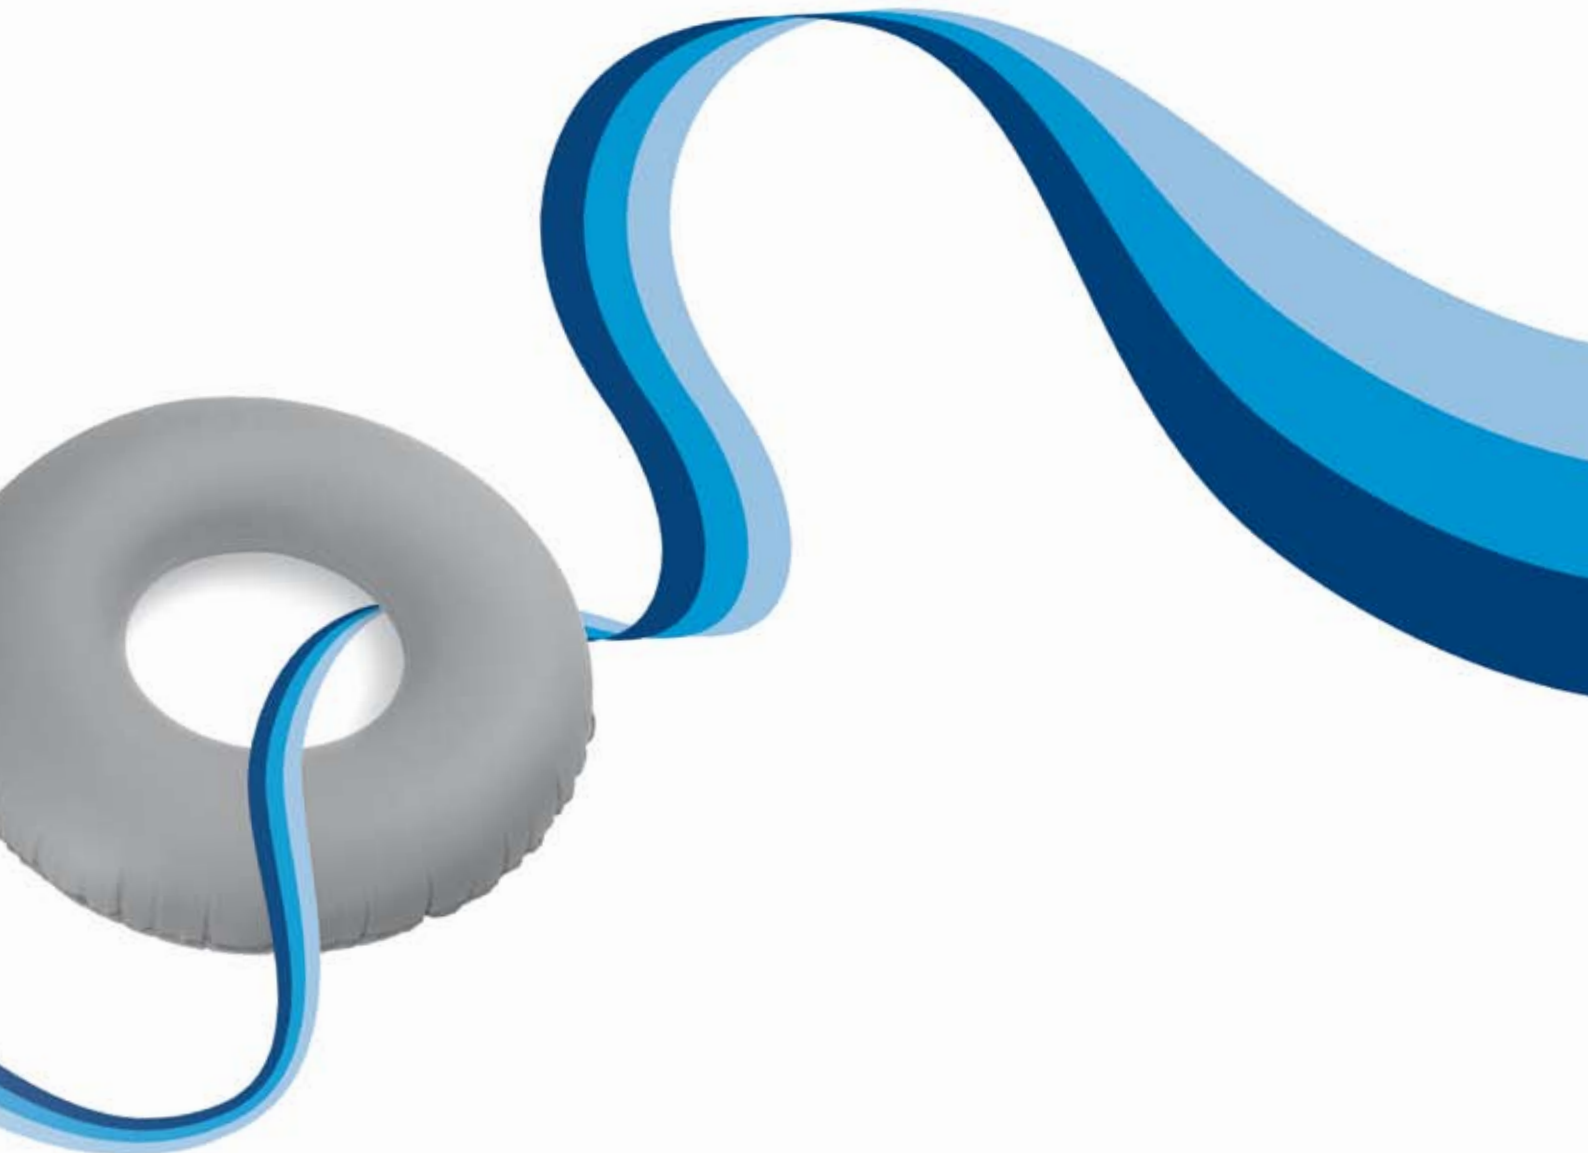

Controlling condensation

As air temperature increases, it can hold more moisture in the form of invisible water vapour. Pool hall temperatures can hold more moisture than air at ordinary room temperatures, causing condensation to occur as the warmer, moist air moves over cooler surfaces.

Condensation is rarely an issue in most buildings and even then is predominantly a cosmetic problem which can be caught before it does too much damage. Swimming pools, however, have additional complications. For example, the condensate may contain aggressive chemicals from the water treatment process or there may be a suspended ceiling concealing the structure, so that damage may occur unnoticed.

There are two ways to avoid this happening:

- Insulate the cold surface on which condensation might occur so that the surface temperature is always above the dew point. The 'dew point' refers to the temperature at which the air is saturated with water vapour, corresponding to 100% relative humidity – as the air temperature falls towards dew point this is when condensation occurs. The insulation should preferably be located outside the structure so that the whole of it remains warm.
- Reduce the moisture in the air so that the relative humidity is less than 100% when it contacts the cold surface.

Safety first

Condensation-related damage can occur out of sight and pool roofs have been known to collapse due to undetected corrosion. It is important to carry out regular preventive checks and always consult a qualified specialist where necessary.

Controlling humidity

Regardless of whether air flow patterns have been arranged to reduce evaporation, it is important to control moisture condensing on cold surfaces by limiting humidity. The alternative methods of dehumidification are:

- To dilute the air close to surfaces which are prone to condensation with dry air from outside the building
- To directly dehumidify the air.

Dilution

Outside air normally has much less moisture in it than pool hall air as it has a lower temperature. Mixing outside air with pool hall air can reduce overall humidity. The outside air has to be heated up to the pool hall temperature to make it comfortable for bathers, which uses energy. To make room for this incoming air, the air already in the pool hall must be extracted. Pool hall air has a high temperature and also contains the latent heat of the moisture evaporated from the pool so it can be wasteful. However, some of this energy can be captured and returned to the pool hall, thus achieving savings (see the heat recovery section on page 9).

The volume of incoming air used to dilute the pool hall air can be reduced to the minimum consistent with avoiding condensation by using variable speed fans.

Direct dehumidification

This approach strips moisture out of the air within the pool hall system, rather than simply diluting it with outside air. In this way, the heat required to maintain conditions in the pool hall is reduced to what is needed to replace direct losses through the building structure and the heat needed to warm fresh air needed for respiration.

The two main ways to achieve this are through the use of a dehumidifying heat pump or a desiccant wheel. The cost effectiveness of both options needs to be evaluated carefully in life cycle terms. In either case they need to be able to cope with the corrosive air they have to handle, which can considerably reduce plant lifespan if not addressed. In addition, both options need to be controlled to achieve the correct function, and the control regime must be understood by plant operators as direct dehumidification is a radically different approach from that traditionally employed.

Dehumidifying heat pumps

A dehumidifying heat pump consists of an electrically driven heat pump where air from the pool hall passes over the evaporator or cold coil. Moisture condenses out of the air at the same time as it is cooled and the water is run to drains (or can be stored for cleaning or toilet flushing). The air is then reheated by passing it over the condenser or hot coil of the heat pump. Thus the air is dehumidified and returned to the pool hall at the right comfort temperature.

The considerable latent heat in the air being dehumidified produces a surplus that can be used to heat the pool. This can make up for the cooling effect caused by surface water evaporation from the pool in ordinary use. The recycling of otherwise wasted energy from the latent heat of the air used to heat the pool water makes this system highly energy efficient.

If the pool already has a heat pump dehumidification system installed, make sure that:

- The controls are set up as recommended by the original installer
- Recovered heat is returned to both pool hall air and pool water
- The dehumidified air returns to the pool hall and is not exhausted to outside
- Cooling coils are clear from blockages or corrosion so that air flow through them is not impeded.

Desiccant wheels

A desiccant wheel passes air from the pool hall through a disc comprising a hygroscopic honeycomb matrix which absorbs the moisture. Thus the air is dehumidified and returned to the pool hall without much change in temperature. The disc rotates and a separate hot (usually gas-fired) stream of air is passed through it to remove the moisture and recharge the wheel ready for its next pass through the pool hall extract air-stream. The hot air is discharged from the building with the water vapour.

A plate heat exchanger or run-around coils can be used to recover some of this waste heat, to preheat incoming fresh air to the pool hall. For further information and details of suppliers, contact the Carbon Trust on **0800 085 2005**.

If the pool already has a desiccant wheel dehumidification system installed, make sure that:

- The controls are set up as recommended by the original installer to reduce the humidity only to that level required to avoid condensation on the structure
- The hygroscopic material is still actively absorbing moisture
- Heating of the hygroscopic material is limited to the amount needed to regenerate it, in order to avoid waste.

Although humidification control (using dehumidifiers for example) can control pool hall humidity conditions, this does not replace the need for adequate ventilation to control air quality.

Ventilation rates and controls

The ideal ventilation rate for a pool hall varies in accordance with a number of factors such as the number of bathers, evaporation rate and water quality at any given time. A recommended guideline figure of 10 litres of ventilation air per second, per square metre of total pool hall area (water area plus all wet surrounds) is acceptable for a wide range of pool complexes. This normally results in an overall total of approximately 4–6 air changes per hour depending on the height of the pool hall.

Ideally, the speed of the ventilation fans should be controlled using variable speed drives (VSDs) linked to a dew point sensor. This optimises the speed of the fans to keep the moisture content of the air in the pool hall just above the dew point at which condensation occurs. Further information can be found in the Carbon Trust's factsheet *Variable speed drives* technology guide (CTG006).

Place the sensor so as to avoid condensation on the worst 'cold bridge' in the structure. A cold bridge is formed where the thermal insulation barrier is breached, leaving a bridge that short-circuits the thermal insulation and results in a colder surface than the surrounding area. In a pool building, this will usually be a window frame or structural steel.

As an alternative to dew point sensors, a relative humidity sensor can be employed to control the air supply. It should be reset depending on the outside temperature. When the outside temperature is below freezing, for example, the relative humidity required to avoid internal condensation will be lower than in milder weather or summer. Note that these sensors require frequent recalibration.

Did you know?

Extensive water features cause more evaporation so pools with these may have to have 8–10 air changes per hour as a result.



Heat recovery

Heating the supply air is generally one of the major consumption areas for a pool building. Providing a simple heat exchange device, such as a plate heat exchanger or run-around coils, can optimise energy efficiency by reclaiming large amounts of lost energy from the exhaust air.


Fit heat exchangers with a bypass in the ductwork for occasions when heat recovery is not required. However, make periodic checks to ensure that they are not permanently bypassed and normally operate in the 'heat recovery' position.

Plate heat exchangers

Plate heat exchangers consist of glass, metal or plastic plates arranged in a stack with the exhaust air and incoming air flowing in the adjacent channels. Heat transfers from the outgoing air from the pool hall (which is warm and moist) through the plates to the cold incoming air. They are cheap and free from mechanical problems, although a limit on their application is that the incoming and outgoing air ducts must be adjacent to each other.

If grease and grime are allowed to build up on the plates this will lead to a substantial reduction in their effectiveness, so the heat exchanger should be maintained in accordance with manufacturers' specifications. If the plates are made of metal, chlorinated air can attack them. Inspect for signs of corrosion at least once a year.

Figure 3 Simplified diagram of a pool hall air handling system

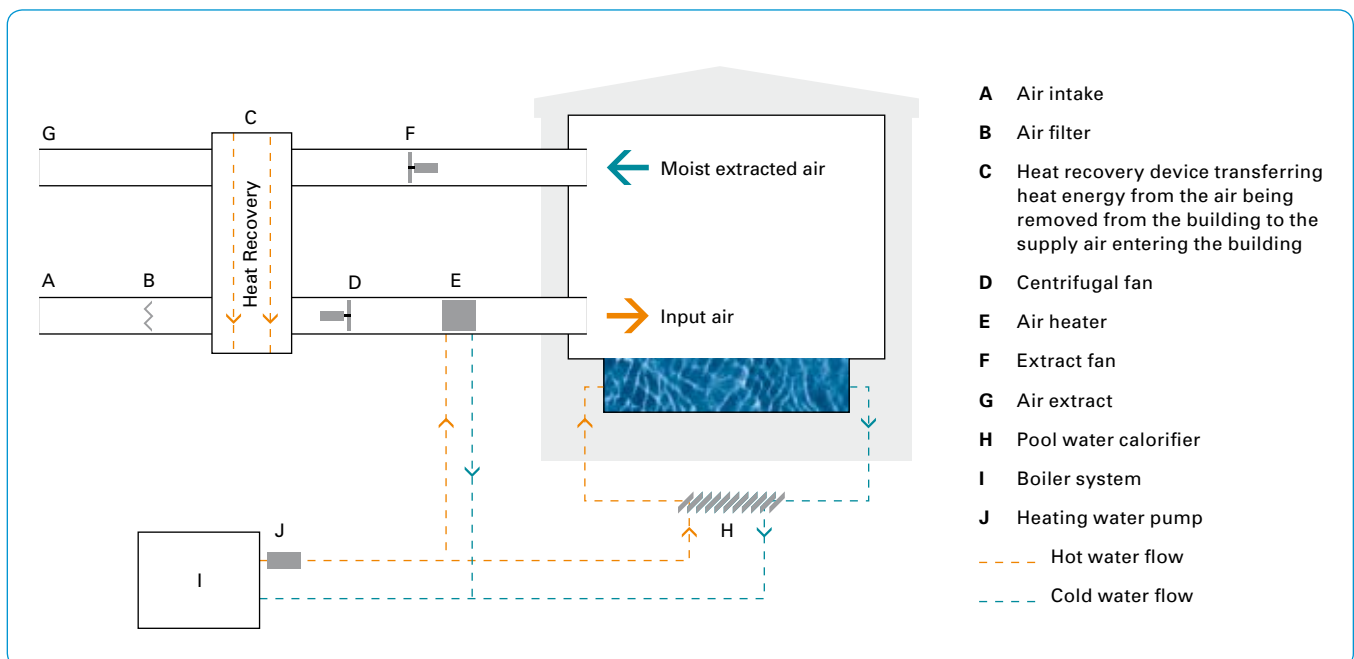


Rotary heat exchangers

Rotary heat exchangers or ‘thermal wheels’ are honeycomb meshes that slowly rotate and alternately pass through the outgoing warm air stream (where they absorb heat) and then through the incoming cool air (where they release heat). They can save considerable energy, although their application again depends on the incoming and outgoing air ducts being adjacent to each other. The honeycomb mesh has to be chosen carefully to be compatible with the moist, chemically aggressive condition of the pool hall air extract.

Rotary heat exchangers have particular maintenance requirements associated with their drive and seal mechanisms yet are very effective and popular. Where the wheel is easily visible, a daily check should be made to confirm that it is rotating at the manufacturer’s recommended rate. In addition, check every six months that:

- The wheel is rotating at the correct speed
- The bearings are lubricated
- The seals are in good condition
- There are no signs of corrosion
- The honeycomb mesh is clean.

It is important that rotary heat exchangers are inspected. If they stop rotating and become blocked, ventilation will be significantly reduced which could lead to condensation in the building structure with serious consequences.

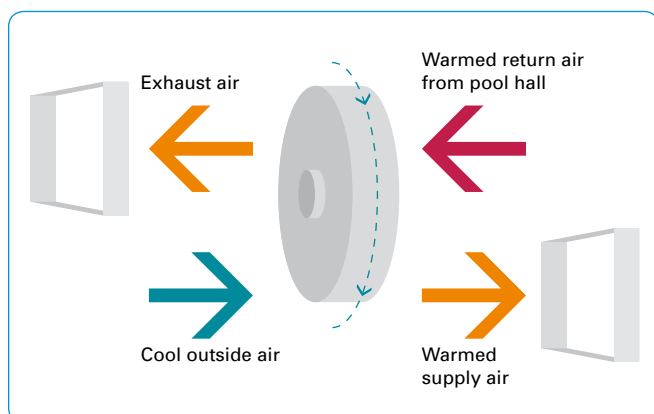

Run-around coils

In this device, two pipe coils are connected by a pumped water circuit. One coil is placed in the extract duct to pick up waste heat, the other in the supply duct to pre-heat incoming air. The advantage of this system is that the two ducts do not have to be adjacent and so it can be retrofitted to an existing ductwork installation. If heat recovery is not required, the pump can be turned off.

The disadvantage of this system is that it is not as effective as other heat recovery methods owing to heat losses from pipework between the two coils and the energy used to drive the pump.

Note

All heat recovery devices should be carefully evaluated over the projected life cycle of the building services installation. They may save heat energy (usually fossil fuel) but increase electricity usage in the fan motor, which is more carbon intensive.

Other considerations

Choice of heat source

When undertaking refurbishment, specify high efficiency condensing boilers or consider installing combined heat and power (CHP). This is covered more on page 18.

Case study: Luxury hotel

A large luxury hotel with a heated indoor swimming pool installed a CHP system which interfaced with other hotel services, including the Building Energy Management System (BEMS). In its first 11 months of operation, the unit generated 2.0 million kWh of electricity and 2.8 million kWh of heat, providing annual savings in excess of £50,000 and reducing carbon dioxide emissions by 1,000 tonnes per year.

Ductwork and dampers

Ductwork should be checked annually to ensure that:

- It is internally clean and free of leaks, especially at duct junctions
- Insulation is sound
- Flexible connections between ducts and fans or other plant are not taut or split. If dust is found, this may indicate leaks or loose panels elsewhere, or failure of filters, and should be investigated.

It is essential to either remove or protect any sensors when ductwork is cleaned.

Dampers are used to control whether air is routed through one duct or another, the proportion of fresh to recirculated air, and the emergency cut off to stop air movement in case of fire. Checks should be conducted to ensure:

- They are operating correctly in accordance with the control strategy (at some pools they have been found to be operating in the opposite direction to that intended)
- They are lubricated regularly to avoid being jammed in one position.

Correct control

Make sure appropriate time and temperature control regimes are in operation and consider interlocked controls so that heating and cooling cannot operate at the same time. It is essential to understand the consequences before changing any temperature or humidity settings in order to avoid damaging the building fabric. Always consult a qualified technician.

Further information can be found in the Carbon Trust's overview of *Heating, ventilation and air conditioning* (CTV003) and *Heating control* (CTG002).

Pool water – heating and treatment

Water heating is essential for efficient operation of the pool, showers and other facilities in a pool building. Since the pool water itself is recirculated continuously, it needs to be disinfected. Although the chemical treatment of pool water is not considered in this guide, its quality and the associated processes do have energy consumption implications.

Pool water heating

The heating of pool water is a relatively simple operation which is generally carried out by the introduction of a heat exchanger to transfer heat from the primary heating system, sometimes via heat recovery systems, to the pool water. The heater is typically sized, based on raising the pool water temperature by 0.5°C per hour (to adjust temperature and 'make good' heat lost by, for example, evaporation and backwashing).

If a pool is being heated from cold, the rate must be no more than 0.25°C per hour, otherwise the expansion of materials may cause problems to the pool structure or lining. For new pools, the precise rate of temperature rise should be predetermined by its designers. Correctly specified and operated controls are the key to efficient pool heating.

Ideal water and air temperatures

There has been a consistent trend towards higher water temperatures in recent years, encouraged by the substantial growth in leisure pools and special events such as swimming sessions for young children. Currently, main pool temperatures tend to be set around 29–30°C. This increase has been in response to customer feedback, particularly in leisure pools where there is less actual swimming activity.

Some pools do need to be this warm, for instance when catering for parents and toddlers or for rehabilitation purposes. However, operators tempted to increase temperatures should bear in mind that this creates a number of problems.

For example:

- Micro-organisms multiply faster – up to twice as fast for a 10°C rise meaning that filters are increasingly likely to become colonised.
- Bathers get hotter, limiting serious swimming and increasing sweat and grease in the water.
- Energy costs and carbon emissions, direct and indirect, are higher regardless of the efficiency or conservation methods used.
- Air temperatures – being linked to water temperatures – also rise, making the atmosphere less comfortable for staff and spectators.
- There is more moisture in the pool atmosphere, even when relative humidity is controlled at the same level. This increases the risk of condensation and possibly corrosion and deterioration of the building fabric, structure and equipment.
- Dissolved gases become less soluble, leading to increased chemical odours and a rise in the pH value of the treated water as carbon dioxide escapes.

With an increasingly wide variety of pool activities taking place, and with operators attempting to introduce more flexibility into pool operation programming, it is difficult to select a single appropriate or optimum operating temperature for any particular pool. The large volumes of water involved make it impossible to vary water temperatures to a great extent in any one area. This means that selection and accurate control of the optimum water temperature for each pool is essential.

The air temperature in the pool hall should be similar to the water temperature – ideally 1°C above. This helps reduce evaporation and convection of heat at the pool surface. It also makes it more comfortable for bathers leaving the pool. Air temperatures of 30°C or more should generally be avoided.

Recommended water temperatures

27°C – competitive swimming and diving, training, fitness swimming

28°C – recreational use, conventional main pools and adult teaching

29°C – children’s teaching, leisure pools

30°C – babies, young children, disabled

Further information

You could also consider alternative heat sources such as a biomass boiler.

See our case study on *Mid Argyll Swimming Pool* (CTS043).

Evaporation

There is a direct link between the energy consumption of ventilation systems and evaporation of water vapour from the pool. The amount of heat energy in the pool which is lost to evaporation depends on the air conditions immediately above the pool. This energy, together with a small amount of heat loss through conduction and radiation, represents a major part of the energy exchange from the pool to the pool hall air. Controlling this is therefore key to saving energy.

The rate of evaporation from the pool depends on the difference between the moisture content of the air at the water surface, the moisture in the air just above the surface and also the air velocity. If the air above the surface can be as stationary as possible, it will become saturated and evaporation will be minimised. If the air moves, however, drier air will enter the space immediately above the pool, the moisture difference will increase and evaporation will increase. Thus the key to reducing evaporation is to minimise the air movement immediately above the pool.

This will inevitably conflict with bathing activity in the area, so some evaporation will always take place when the pool is occupied. This is why the pool must be continually heated even after it has been warmed up, to maintain bather comfort.

Evaporation is also increased if the water is sprayed or agitated by water features such as wave machines or flumes, because the surface area is increased. To prevent wastage, limit the use of water features, rather than operating them continuously. As well as reducing evaporation, this will also reduce pumping energy and provide a more varied swimming environment.

When the pool is unoccupied it may still be necessary to run the pool ventilation system to maintain environmental conditions within the pool hall to prevent condensation.

Pool covers

The use of pool covers out of hours reduces the evaporation rate from the pool surface and can save significant amounts of energy in swimming pools.

- The lower evaporation rate reduces the energy needed to keep the pool water heated to the required temperature and the resulting reduction in energy use is significant.
- The reduced evaporation lessens the need for high ventilation rates and air heating in the pool hall can be reduced or shut off. This allows the air circulation system to be shut off, or turned down to a very low rate, when the covers are on.

In practice, some water may get on to the top of the pool cover and there may be some evaporation at the sides where the cover does not quite fit. There may also be some residual moisture in the air after the cover has been deployed so it may still be necessary to run the ventilation system at a low setting. Nevertheless, an effective pool cover will reduce the need for dehumidification out of hours and therefore substantially reduce energy consumption. Even where covers do not match the shape of a free form pool, they are still worthwhile: evaporation is still reduced in proportion to the area covered and hence yields energy and cost savings.

A wide variety of covers is available, including motorised models which can be withdrawn to the side or bottom of the pool to minimise the labour input at changeover. When selecting a suitable cover, consider the following factors:

- Resistance to water treatment chemicals and UV light
- Strong and durable materials and construction
- Good insulation properties and suitable fitting
- Storage ability and ease of use
- Safety requirements for staff and pool users.

Pool covers also provide additional benefits in terms of building maintenance. A reduction in pool hall humidity and condensation can help to prolong the life of the structure and reduce building maintenance.

It is important to train staff to use covers properly – and regularly – in order to achieve maximum energy savings. Ensure staff and lifeguards have adequate safety training to ensure that they know what to do should anybody become trapped underneath a cover.

Did you know?

Insulated pool covers are one of the most cost effective investments available to swimming pool managers. Typical savings can be 10–30% of total pool energy use with a payback period of 18 months to three years.

An effective pool cover will reduce the need for dehumidification out of hours and therefore substantially reduce energy consumption

Pool water treatment

Although the chemical treatment involved in this process is outside the scope of this guide, it should be noted that most systems rely on a residual chemical level to deal with pollution input as the water circulates through the pool. There will always be some air contamination from the volatile products of the water treatment process, and hence a need for ventilation to dilute the smell.

Most treatment systems incur a build-up of dissolved solids which must be reduced periodically by dilution and often by backwashing. Backwashing refers to a process where the flow of the pool water through the filter is reversed to flush out the accumulated debris, such as hair, in the filter.

The water used in dilution must be reheated, as must the fresh water used to replace that used to backwash the filters. This will have to be heated up from the mains supply to the comfort temperature of the pool, requiring energy input from the boiler or other heat generator.

It is important to maintain an appropriate interval between consecutive backwashes of a pool filter to reduce energy and water consumption. Backwashing is very costly in both water and energy terms so any reductions in this area will lead to significant cost savings.

Although energy can be saved by minimising the water quantity going to waste, take special care to avoid compromising water quality and safety. The interval between backwashes will depend on the type of pool and the degree of usage. Some pools will remain clean and safe with regular cyclic backwashes but some manufacturers advise that the pressure drop across a filter is a better indicator of when a backwash is required. Always consult the manufacturer of the pool equipment when considering changing the maintenance regime. Further information can be found in HSE guidelines at www.hse.gov.uk

In swimming pools, it is important to ensure full mixing of the water in the pool after filtration/disinfection, so that there are no pockets of poor quality water which are not refreshed. The turbulence near inlets to achieve this may give the appearance of unnecessarily high pressures. If this is the case, consult the pool water designer on whether the pressures at the pump are really necessary to maintain adequate mixing. If pressure can be reduced (through changing impellers or by reducing motor speed) energy can be saved. Note that high pressure may also be necessary to operate filters and filter cleaning.

Showers

Pollution of the pool water, for example through sweat, urine or cosmetics is a big issue for pool operators. A build up of pollution can be reduced by encouraging bathers to shower and use the toilet before entering the pool. While this may increase shower water heating, it reduces the need for disinfection and filter backwashing and may improve the appearance of the pool. Moreover, there are ways to lessen the effect of the extra hot water demand. For example, reduce the quantity used by bathers by introducing push button controls instead of conventional taps, so that they are not left running.

In some circumstances, where sewers are unable to take large sudden outflows of water, for backwashing, say, the centre must store the water and discharge it at a slow rate. In this case, energy could be saved by applying water to water heat recovery to preheat incoming water which enters the building at approximately the same rate as this discharge. Any heat exchangers used in this way should be capable of being dismantled to allow periodic cleaning.

During refurbishment projects, install a dedicated hot water heater for showers rather than storage calorifiers which are prone to energy losses. Make sure that the insulation is intact and at the required thickness in hot water storage systems.

Explore solar water heating potential

Solar water heating can be very effective for showers and for heating pool water. Modern systems are relatively easy to connect to a conventional heating system. Unglazed solar collectors perform well in summer and are generally the cheapest to buy and install. Glazed collectors provide more energy in spring and autumn and can give a substantial contribution to pool heating throughout the year, with the remainder provided by a conventional heating system.

Combined heat and power

Combined heat and power (CHP) is the on-site generation of electricity and the utilisation of the heat that is a by-product of the generation process. It saves energy and reduces carbon emissions by making the engine's heat, which would normally be wasted, available as hot water. It could therefore substantially reduce a swimming pool's electricity requirement from the mains supply. It will increase gas use to some extent because CHP produces hot water with less efficiency than a boiler. For larger swimming pools, CHP can offer an economical method of providing heat and power which is less environmentally harmful than conventional methods.

To gain maximum benefit from CHP, the system needs to be in operation for as many hours of the year as possible. With year-round requirements for electricity and hot water, swimming pools can be well suited to using CHP although the economics depend on the relative prices of purchased gas and displaced electricity. Use proprietary CHP sizing software to find out whether it is worthwhile. An expert should thoroughly investigate the site and carry out a complete financial and technical appraisal. For more information call the Carbon Trust on **0800 085 2005**.

Did you know?

In an appropriate application, CHP can reduce energy bills by around 20–30%, provided the unit is designed to meet the building's seasonal demands for electricity and heating. Even better, good quality CHP qualifies for Enhanced Capital Allowances and the fuel input is exempt from the climate change levy (CCL). Contact the Carbon Trust for more information.

Top tip

Ensure pipework is checked regularly for leaks. A leaky pipe costs money for the water and heat being wasted. To reduce energy losses, also make sure that pipework is properly insulated. Regularly check the condition of insulation and replace if it is damp or worn.

Effective maintenance for heating plant

Have boilers serviced regularly by a reputable firm. Gas-fired boilers, which are most common in leisure facilities, should be serviced once a year; oil boilers twice a year. A regularly serviced boiler can save as much as 10% on annual heating costs.

Insulate boilers, hot water tanks, pipes and valves to prevent heat escaping. Payback can usually be expected within a few months of installation, with additional savings in subsequent years.

As well as providing heat for the pool hall, boilers also provide hot water which is used in changing rooms and catering facilities, so it is particularly important to keep them in good condition and as efficient as possible.

The Carbon Trust has further advice on energy saving with boilers, including a *Low temperature hot water boilers* technology overview (CTV008).

Lighting

Lighting accounts for up to 16% of the total energy costs in an indoor pool hall or wet leisure facility. There are many simple and inexpensive ways to reduce the energy consumption and costs associated with lighting without compromising internal comfort levels.

As well as selecting energy efficient light sources, there are a number of important design issues to consider when lighting a swimming pool. These include:

- Minimising reflected glare from light fittings off the pool surface
- Ease of maintenance when replacing bulbs and cleaning fittings
- Sourcing light fittings that resist corrosion
- The colour performance of lamps.

Some key efficiency measures are outlined below. More detailed information relating to lighting and controls is available in the *Lighting* technology overview (CTV021) available from the Carbon Trust.

Tax incentives

Enhanced Capital Allowances (ECAs) enable businesses to buy energy efficient equipment using a 100% rate of tax allowance in the year of purchase. Businesses can claim this allowance on the investment value of energy efficient catering equipment if it is on the Energy Technology List. The procedure for claiming an ECA is the same as for any other capital allowance. For further information, please visit www.eca.gov.uk or call the Carbon Trust Customer Centre on **0800 085 2005**.

Further information


Lighting technology overview (CTV021).
www.carbontrust.co.uk/lighting

For help implementing energy efficient lighting, see www.carbontrust.co.uk/lightingimplementation

Choose efficient replacements


When a lamp fails, it presents a useful opportunity to substitute a more efficient lamp type. Lighting technology progresses quickly and alternatives should be investigated, especially when refurbishment is being undertaken. Consider the substitutes outlined below and avoid automatically replacing like with like.

Replace standard lamps




Replace standard incandescent tungsten filament lamps with compact fluorescent lamps (CFLs) that last up to eight times longer than their tungsten counterparts, which means less time spent replacing them. They have a similar light output to tungsten bulbs and use only 20–25% of the energy.

Replace T12 tubes with T8 and T5 tubes



All 38mm diameter (T12) fluorescent tubes can be replaced with slimmer, 26mm diameter (T8) tubes. When replacing luminaires – the light fitting – consider those that will take the more efficient T5 fluorescent tubes. Always specify tubes with a triphosphor coating – this will be stated on the packaging.

Consider long-life lamps



If lights are placed in difficult areas to reach, for example directly over the centre of the pool, choose long-life lamps such as metal halides and sodium lamps. Metal halide lamps can be used in the pool area and in other areas where the colour rendering properties of high pressure sodium lamps are not sufficient.

Consult a lighting specialist

For new build or refurbishment projects, consult a lighting designer or dedicated lighting specialist. In most cases, a qualified designer will be able to identify savings whilst maximising the quality and aesthetics of the final result. When commissioning a designer, it is important to work through the actual requirements of the finished design and ask them to specifically consider:

- The safety and comfort of staff and pool users
- The pool hall architecture and layout of the building
- How the design can help to achieve the lighting requirements, including any specialist needs such as lighting for swimming or diving competitions (see below)
- How the use of daylight can be maximised including utilising suitable controls
- The costs of installing and operating the system including maintenance costs and ease of access
- The most energy efficient design possible – make sure that low energy options are specified from the outset.

Competition pools

The Fédération Internationale de Natation (FINA) specifies particular rules and regulations for pools offering competitive and training facilities. For example, provision of a higher lighting level than that used for recreational swimming is required for competitive events. Moreover, if a pool is to be used for competitions under FINA rules, consideration should be given to separate switching regimes. For more information, visit www.fina.org

Daylighting

Most swimming pools have good levels of natural daylighting from windows or roof lights. In many cases, there will be sufficient daylight to allow some artificial lighting to be switched off during the day. Appoint a staff member to ensure this occurs and, if necessary, change the switching arrangement so that selected lights can be turned off separately using appropriate daylighting controls.

Cleaning windows and skylights regularly will allow maximum daylight to enter the pool hall and significantly reduce the need for electric lighting. Clean glass is particularly important for urban swimming pools where high levels of pollution can cause a film of dirt to settle on windows and particularly roof lights.

Where daylight is used in the pool hall, ensure that lifeguards are positioned so that their view under the water is not obscured by reflections from bright windows or interior light sources.

Motors and pumps

Motors, fans and pumps are used widely throughout the pool building for water treatment and ventilation systems. Collectively, they are responsible for more than 25% of the energy costs in swimming pools so making motors and pumps more efficient will yield significant savings.

Switch-off policy

There are many motors in the average pool hall and they are usually hidden within machinery. So motors tend to be ignored or left running even when they are doing no useful work. Develop procedures to ensure that 'idle' motors and pumps are switched off when not in operation. This may involve devising a switch-off procedure and placing instructions in visible locations around the building. The procedure should also take into account the maximum number of 'starts' allowed for each motor.

Clean components

Motors should be kept clean and free of dust and other contaminants. Pay particular attention to motors situated in the corrosive atmosphere of pool water treatment areas or those in dirty or dusty environments. Consider putting a preventive maintenance plan in action to address this issue.

Correct motor sizing – over-sizing leads to inefficiency

A smaller motor running at a higher loading will be more efficient than a larger, partially loaded motor and it will consume less energy. For example, swapping a single 10kW motor running at 25% loading for a 2.5kW motor running at full load could save around £70 per year.

High efficiency motors

High efficiency motors (HEMs) rarely cost more, but use between 3–5% less energy. They also qualify for 100% tax relief under the Enhanced Capital Allowance scheme. Visit www.eca.gov.uk for more details. HEMs make a good replacement option for an existing failed motor.

Variable speed drives

In applications where a motor is required to serve a variety of load conditions, such as varying supply and extract volumes to remove moisture in a pool hall, consider installing a variable speed drive. These devices can alter the speed of a motor, enabling the motor to operate efficiently in a range of different conditions.

Did you know?

The cost of buying an electric motor can be deceptive. In just a single year, the cost of the energy required to run a motor can be up to 10 times its purchase cost.

Further information

For more detailed information on energy savings and motors, see the Carbon Trust's *Motors and drives* technology overview (CTV016).

Action checklist

Existing systems	Complete?	Action/Comment
Ensure air temperature is set at 1°C above water temperature to avoid convection air movement		
Control ventilation rates with a dew point sensor to the minimum rate consistent with avoiding condensation		
If existing control is by humidistat, reset each season according to the outside temperature		
If ventilation volume is set at 'full' or controlled manually or by timer, investigate how to link this with humidity levels as an alternative option		
Reposition supply air outlets so that drier supply air entering the pool hall is pointed towards the building structure rather than down on to the surface of the pool water		
Keep doors closed between areas with different temperatures and humidity		
Provide localised cooling for staff using overhead fans and discourage staff from opening doors and windows if they are hot		
Conduct regular pool backwashing and clean the pool filters to maintain good quality clean water		
Benchmark separately for fossil fuels and electricity to show potential for savings		
Inspect system components such as fans, coils and pumps for corrosion and clean or replace if necessary		
Minimise the frequency of backwashing consistent with achieving the required minimum standard of water quality		
Provide heating, lighting and hot water only to occupied areas		
Inspect heat recovery devices and air filters once a month and clean or replace if necessary		
Walk around the premises at different times of the day and during different seasons to see how energy is being used. Develop an action plan for making savings		
Refurbishment and capital expenditure		
Fit pool covers to minimise evaporation and ensure staff are trained to use them properly		
Consider fitting variable speed drives on pumps and fans		
Explore solar water heating potential		
Replace ageing conventional boilers with high efficiency condensing boilers		
Consider combined heat and power; evaluate the economics including maintenance and plant replacement costs		
Consider ventilation heat recovery and waste water heat recovery		
Evaluate options for using heat pumps for dehumidification and utilising the recovered energy for pool heating		
Investigate installing additional insulation and consider insulating any existing cold bridges		

Next steps

Start with the following easy low and no-cost options to help save money and improve the energy performance of your pool hall.

Step 1. Understand your energy use

Look around your pool hall and identify the major areas of energy consumption. Devise a control strategy and ensure it is fully understood and implemented – this is particularly important as many systems are often complex and energy saving features are overridden due to a lack of understanding.

Check the condition and operation of equipment and monitor the power consumption over one week to obtain a base figure against which energy improvements can be measured.

Step 2. Identify opportunities

Compile an energy checklist. Walk round the building and complete the checklist at different times of day (including after hours) to identify where energy savings can be made. An example checklist can be found earlier in this document and further ideas are available in *Assessing the energy use in your building* (CTL003), available from the Carbon Trust.

Step 3. Prioritise your actions

Draw up an action plan detailing a schedule of improvements that need to be made and when, along with who will be responsible for them.

Further information

HSG179: *Managing health and safety in swimming pools*: available at www.hsebooks.com

CIBSE Guide F – *Energy efficiency in buildings*: available at www.cibse.org

CIBSE Guide G – *Public health engineering*: available at www.cibse.org

Fédération Internationale de Natation (FINA) www.fina.org

Step 4. Seek specialist help

It may be possible to implement some energy saving measures in-house but others may require specialist help. Discuss the more complex or expensive options with a qualified technician.

Step 5. Make the changes and measure the savings

Implement your energy saving actions and measure against original consumption figures. This will assist future management decisions regarding your energy priorities.

Step 6. Continue managing energy efficiency

Enforce policies, systems and procedures to ensure your centre operates efficiently and that savings are maintained in the future.



Glossary

Air handlers

The portion of heating and cooling systems that force air through the ductwork of a building. Air handlers usually consist of a sheet metal box housing fans and other equipment such as heating and cooling coils.

Calorifier

An apparatus used for the transfer of heat to water in a vessel by indirect means, the source of heat being contained within a pipe or coil immersed in the water.

Commissioning

The process of testing, checking or calibrating the function of any building services component.

Dew point

The temperature to which the air must be cooled at constant pressure in order for it become saturated so that the relative humidity becomes 100%.

Dew point sensor

Measures relative humidity and identifies the dew point in a body of air.

Ductwork

Distributes the air from air handlers to conditioned spaces. In many buildings, it is hidden behind suspended ceilings and within walls.

Hygroscopic

A material that takes up moisture from the air.

Interlocking controls

Controls that prevent two or more systems operating at the same time.

Laminar flow

The smooth, non-turbulent flow of air or liquid.

Latent heat

The energy that is released or absorbed as heat by a substance as it changes state such as from a solid to a liquid.

Relative humidity

A term used to describe the amount of water vapour that exists in a gaseous mixture of air and water, expressed as a percentage.

Relative humidity sensor

Measures relative humidity in the air and can be used to alter ventilation rates in a pool hall to avoid condensation.

Thermal bridging

The part of the building fabric where heat is transferred at a much higher rate than the surrounding area.

Variable speed drive

An electronic device that controls the electrical supply to a motor, enabling it to run at different speeds.

Zoning

Allows a building to be separated into individual areas based on different requirements. Each zone may have separate time and temperature controls, allowing conditions in each area to be provided with heating or cooling appropriate to its individual needs and thus achieving energy savings.

Go online to get more

The Carbon Trust provides a range of tools, services and information to help you implement energy and carbon saving measures, no matter what your level of experience.

Carbon Footprint Calculator – Our online calculator will help you calculate your organisation's carbon emissions.

→ www.carbontrust.co.uk/carboncalculator

Interest Free Loans – Energy Efficiency Loans from the Carbon Trust are a cost effective way to replace or upgrade your existing equipment with a more energy efficient version. See if you qualify.

→ www.carbontrust.co.uk/loans

Carbon Surveys – We provide free surveys to organisations with annual energy bills of more than £50,000. Our carbon experts will visit your premises to identify energy saving opportunities and offer practical advice on how to achieve them.

→ www.carbontrust.co.uk/surveys

Action Plans – Create action plans to implement carbon and energy saving measures.

→ www.carbontrust.co.uk/apt

Case Studies – Our case studies show that it's often easier and less expensive than you might think to bring about real change.

→ www.carbontrust.co.uk/casestudies

Events and Workshops – The Carbon Trust offers a variety of events and workshops ranging from introductions to our services, to technical energy efficiency training, most of which are free.

→ www.carbontrust.co.uk/events

Publications – We have a library of free publications detailing energy saving techniques for a range of sectors and technologies.

→ www.carbontrust.co.uk/publications

Need further help?



Call our Customer Centre on 0800 085 2005

Our Customer Centre provides free advice on what your organisation can do to save energy and save money. Our team handles questions ranging from straightforward requests for information, to in-depth technical queries about particular technologies.

The Carbon Trust was set up by Government in 2001 as an independent company.

Our mission is to accelerate the move to a low carbon economy by working with organisations to reduce carbon emissions and develop commercial low carbon technologies.

We do this through five complementary business areas:

Insights – explains the opportunities surrounding climate change

Solutions – delivers carbon reduction solutions

Innovations – develops low carbon technologies

Enterprises – creates low carbon businesses

Investments – finances clean energy businesses

www.carbontrust.co.uk

0800 085 2005

The Carbon Trust is funded by the Department for Environment, Food and Rural Affairs (Defra), the Department for Business, Enterprise and Regulatory Reform, the Scottish Government, the Welsh Assembly Government and Invest Northern Ireland.

Whilst reasonable steps have been taken to ensure that the information contained within this publication is correct, the authors, the Carbon Trust, its agents, contractors and sub-contractors give no warranty and make no representation as to its accuracy and accept no liability for any errors or omissions. Any trademarks, service marks or logos used in this publication, and copyright in it, are the property of the Carbon Trust. Nothing in this publication shall be construed as granting any licence or right to use or reproduce any of the trademarks, service marks, logos, copyright or any proprietary information in any way without the Carbon Trust's prior written permission. The Carbon Trust enforces infringements of its intellectual property rights to the full extent permitted by law.

The Carbon Trust is a company limited by guarantee and registered in England and Wales under Company number 4190230 with its Registered Office at: 8th Floor, 3 Clement's Inn, London WC2A 2AZ.

Printed on paper containing a minimum of 75% recycled, de-inked post-consumer waste.

Published in the UK: April 2008.

© The Carbon Trust 2008. All rights reserved.

CTG009

